



ED ZEN+

Suspended

Safety & Warnings:


Risk of fire and electrical shock. Fixture must be installed by a qualified electrician only in accordance with national local building and electrical codes. Disconnect power at electrical panel before servicing. 

General contractor is responsible for the installation of appropriate anchors to support the load of the fixture at positions detailed in the installation manual. Installation of such anchors or other support systems must be completed in accordance with applicable building/installation code.

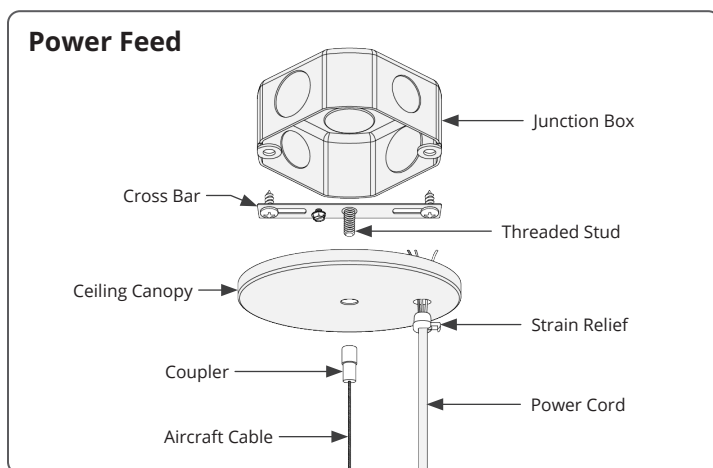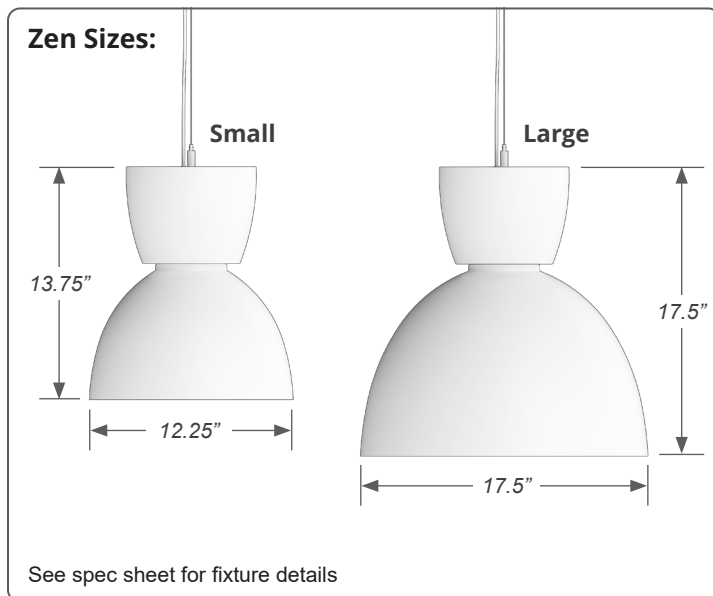

Steps:

1. Turn power off.
2. Attach threaded stud to cross-bar and mount to j-box.
See Power Feed diagram for exploded view.
3. Connect power wires according to Electrical national code, then attach strain relief to ceiling canopy.
4. Raise ceiling canopy into threaded stud and secure with coupler.

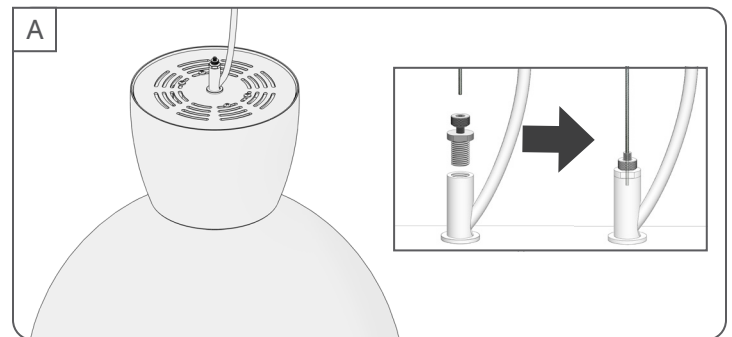

5. Slide aircraft cable to each end of the cable gripper mounted to the fixture (*Fig. A*).
6. Adjust height and cut excess aircraft cable.
7. Turn power on and test fixture.
8. For tunable white controls, download application shown on QR code (IOS only) (*Fig. B*).

